22,500L TANK - OUTLET AND OVERFLOW LOCATIONS

Reseller Name:

Order Number:

Please indicate on the diagram below your preferred location for the below fittings:

- ☐ 2 x 2” BSP Outlet, Located 100mm up from base.
- ☐ 1 x 90mm Overflow

Name Signed Date

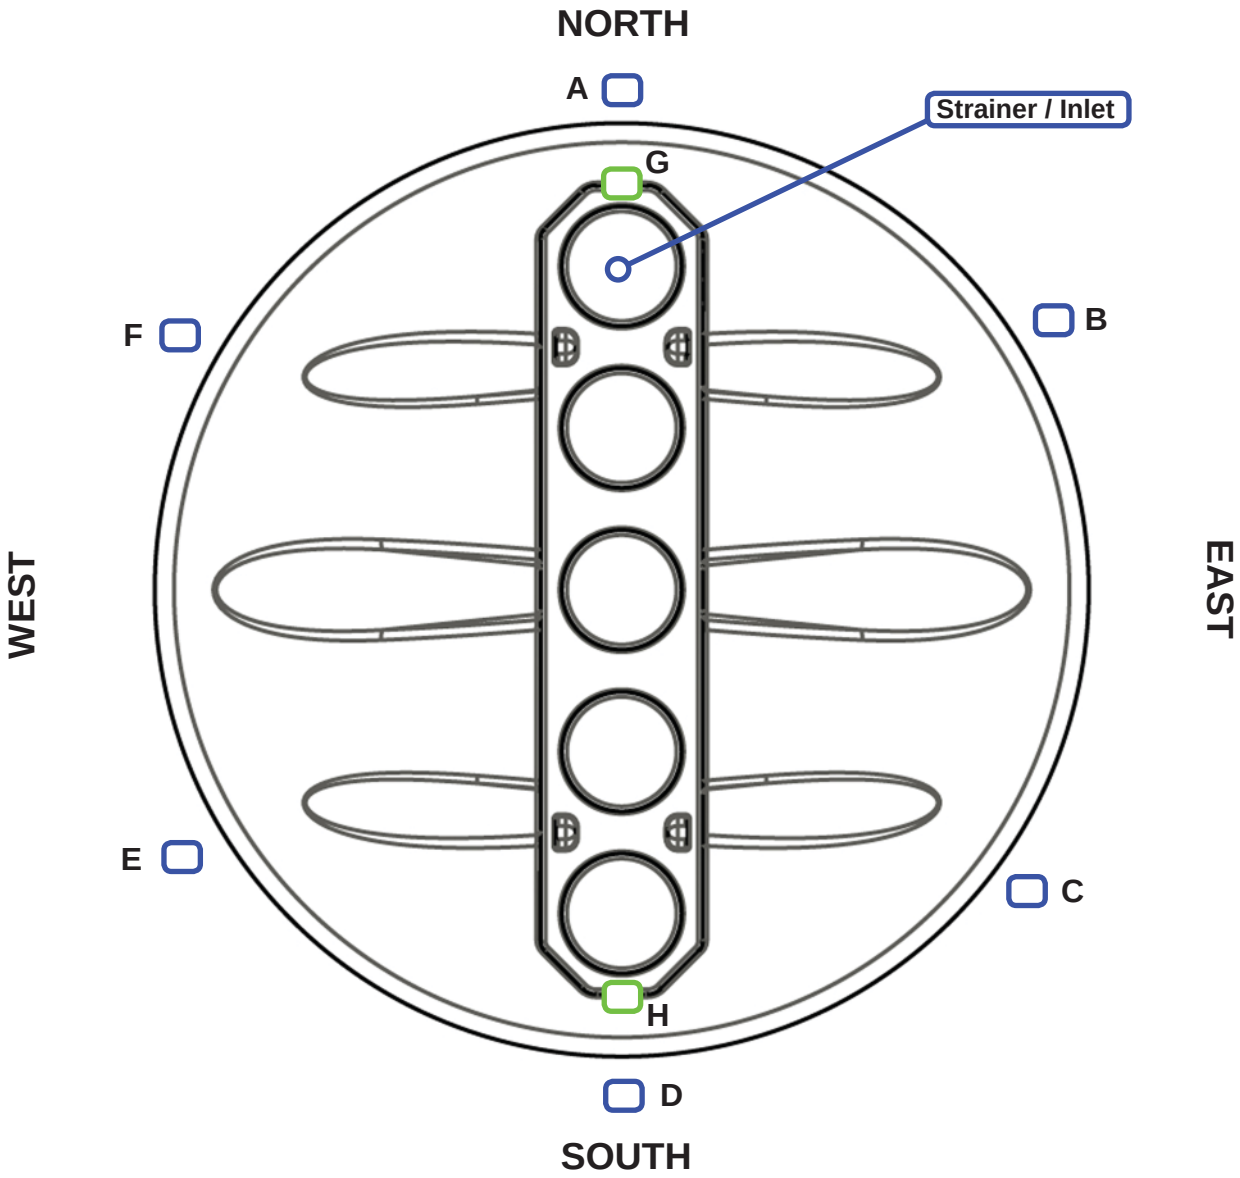

PLEASE NOTE:

Fitting Locations are irreversable.
Please make sure locations are checked to be correct before signing and returning for manufacture